

Inspection Service Interval Guidelines

Regular inspection of the Fresh Air Supply Unit (FASU) filter is integral to ensuring safe and fresh air is delivered at the intended flow rate through the unit. The below regional map (Figure 1) and table (Table 1) indicate the recommended inspection interval for each Queensland Government Region from the original unit installation date.

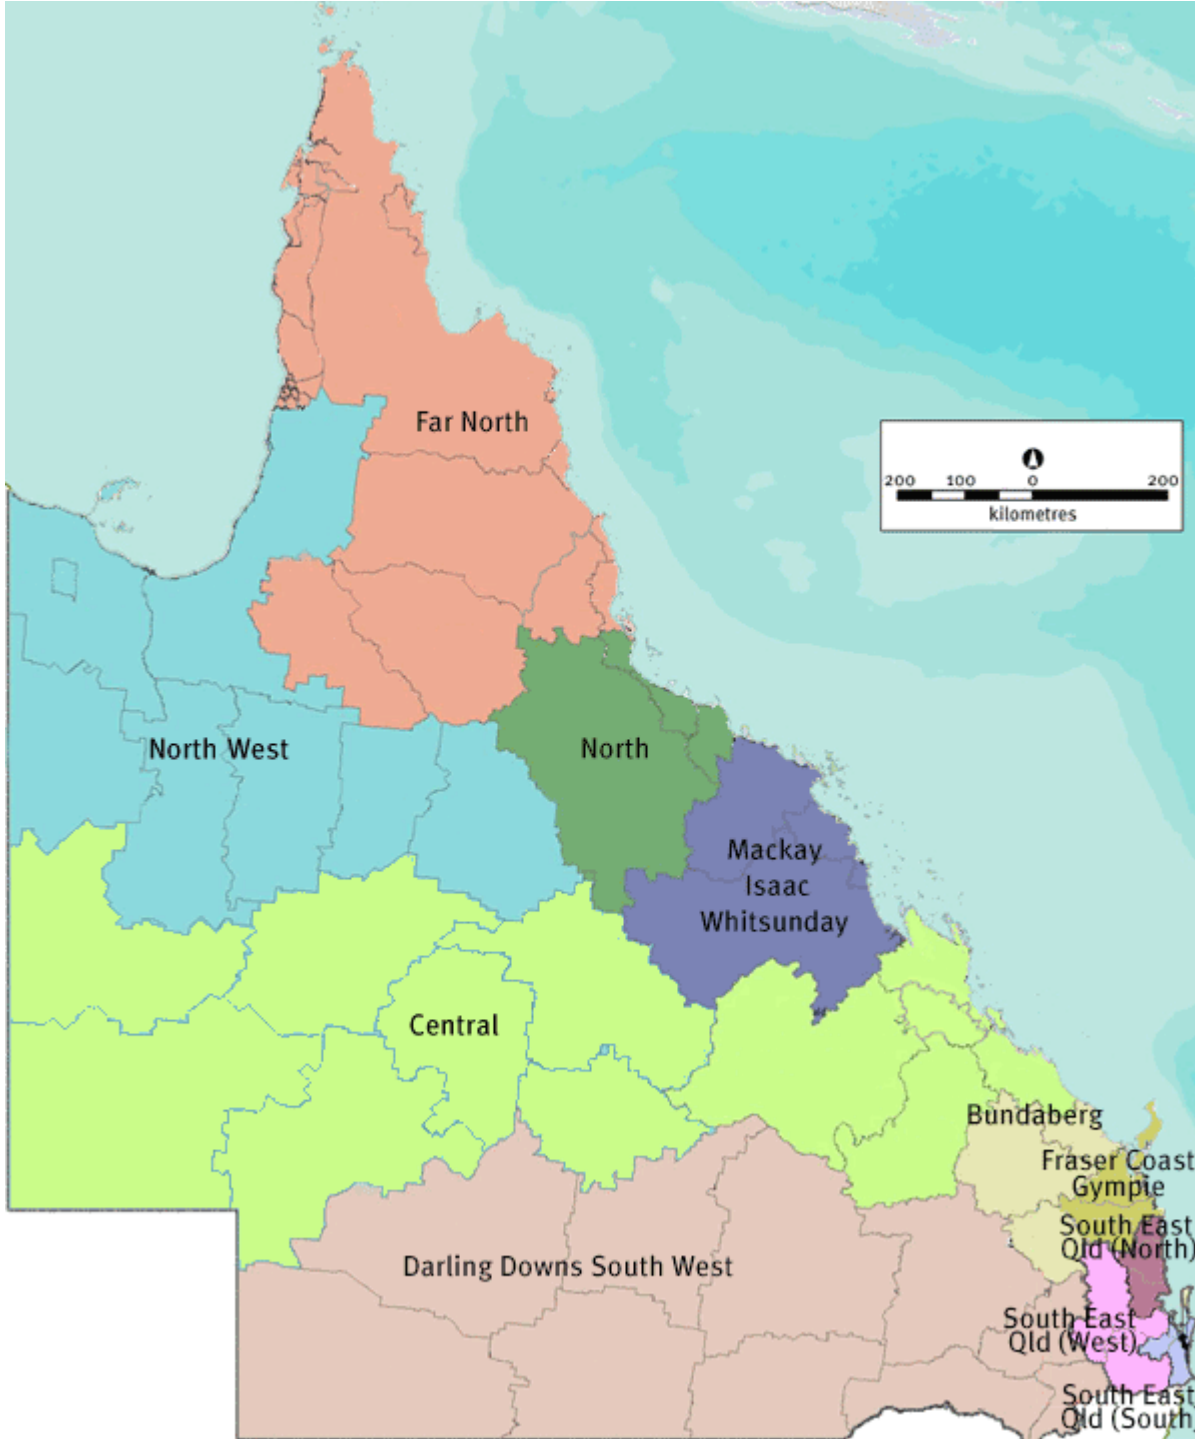


Figure 1 - Queensland Government Region Map

Specific conditions at the installed location will also affect the inspection intervals. This may include: weather conditions, air conditioning systems usage, proximity to dusty environments (roads, workshops).

Region Name	Recommended Inspection Interval
Far North	6 Months
North West	3 Months
North	6 Months
Mackay Isaac Whitsunday	6 Months
Central	3 Months
Bundaberg	12 Months
Fraser Gympie Coast	12 Months
Darling Downs South West	3 Months
South East Qld (North)	12 Months
South East Qld (West)	12 Months
South East Qld (South)	12 Months

Table 1 – Inspection Service Interval Guidelines